



TAC Xenta[®] 471

Analog Input Module

4 Sep 2002



TAC Xenta 471 is an Analog Input module in the TAC Xenta family. It is used as an expansion module for the TAC Xenta controllers, connected by the common network.

The module has eight universal analog inputs. The analog inputs can be used independently for current input or for voltage input. The current input is either supplied internally from the I/O module or from an external source.

TAC Xenta 471 is associated with a specific controller with the assistance of the graphical tool TAC Menta.

If there are several controllers and I/O modules in the same network, a special Device Configuration Tool PC program is used during installation.

The input/output status can be checked from the TAC Xenta OP operator panel connected to any TAC Xenta controller in the same network.

TAC Xenta OP has a display and a minimum number of push buttons.

TECHNICAL DATA

Supply voltage 24 V AC $\pm 20\%$, 50/60 Hz
or 19–40 V DC

Power consumption max. 10 W

Transformer sizing 10 VA

Ambient temperature:

Storage -20 to 50 °C (-4 to 122 °F)

Operation 0 to 50 °C (32 to 122 °F)

Humidity max. 90% RH non-condensing

Mechanical:

Enclosure ABS/PC

Enclosure rating IP 20

Dimensions see diagram

Weight 0.4 kg (0.88 lbs)

Universal Inputs (U1–U8):

Quantity 8

– as Current Input with *external* Voltage power;

Input signal (terminals U–M) 0/4–20 mA

Input resistance 20 ohm

accuracy within 0.02 mA

– as Current Input with *internal* Voltage power;

Input signal (terminals 24 V DC–U) 4–20 mA

Input resistance 20 ohm

accuracy within 0.02 mA

Voltage 24 V DC ± 2 V

Current limit, total value 200 mA


– as Voltage input;

Input signal (terminals U–M) 0–1, 0/2–10 V DC

Input resistance 100 kohm

accuracy within 0.01 V

mm (in.):

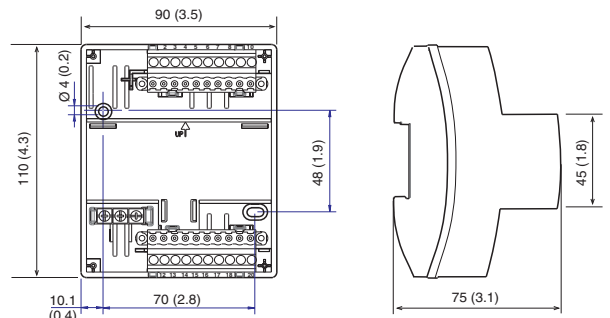

Communication:

Network Echelon LonWorks[®] TP/FT-10, 78 kbps

Agency Compliances:

Emission C-Tick, EN 50081-1, FCC Part 15

Immunity EN 50082-1

Safety:

CE EN 61010-1

UL 916 Energy Management Equipment

ETL listing UL 3111-1, first edition

..... CAN/CSA C22.2 No. 1010.1-92

Flammability class, materials UL 94 V-0

Part numbers:

Electronics part TAC Xenta 471 0-073-0291

Terminal part TAC Xenta 400 0-073-0902



DESIGN

TAC Xenta 471 consists of a terminal and a circuit board mounted together (figure 1). All terminations of field wires are made to the terminal part only. Thus the electronics may be removed for service without affecting the terminal connections.

Universal Inputs

The Universal Inputs can be individually configured for Current Input or Voltage Input. A high and a low limit can be set for each Universal Input.

The Universal Input types are selected via the application program.

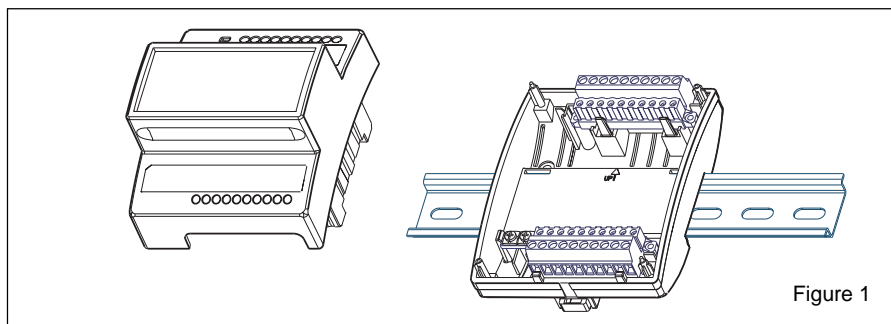


Figure 1

MOUNTING

TAC Xenta 471 is cabinet mounted on a TS 35 mm norm rail EN 50022. The module consists of two parts: a terminal with screw terminals, and electronics with circuit boards. To simplify commissioning the terminal part can be pre-mounted in the cabinet, see figure 1.

If the module is to be wall mounted a wide range of standardized boxes are available.

LED indicators

There are two general LED indicators on the front of the module. One is red and

lights up if there is a hardware fault. The other is green and blinks to indicate that the application program is running.

CABLES

G and G0:

Min. wire size area 0.7 mm²
(18 AWG)

C1 and C2:

The TP/FT-10, 78 system allows the user to wire the control devices with virtually no topology restrictions. The max. wire distance in one segment depends on the type of wire and the topology. For normal applications, using the Belden 85102 cable, the distance may be up to 1640 ft. (500

m). For other applications, please refer to the TAC Xenta Network guide.

The wires are polarity insensitive, but must be a twisted-pair.

Terminals U1–U8:

Min. wire size 0.25 to 0.75 mm²
(23 to 18 AWG).

Max. cable length 20 to 200 m
(65 to 650 ft.).

(please refer to the TAC Xenta 400 I/O modules manual for details).

INSTALLATION

There is a label on the front of the module with both the numbers and the names of the terminals (1 C1, 2 C2 and so on). The numbers are also shown in the plastic of the terminal part.

Service pin

To simplify network commissioning, there is a service pin on the electronic unit which, when pressed, identifies the unit on the network.

If the pin is pressed continuously for more than seven seconds, within 60 seconds after a restart, all values of the unit will be reset to the default values.

The unique Neuron ID is printed on a label on the rear of the unit.

Terminal connections

Term. no.	Term. name	Description	Term. no.	Term. name	Description
1	G	24 V AC/DC	11	M	Measur. neutral
2	G0		12	U4	Universal input
3	C1	LONWORKS TP/FT-10, 78 kbps	13	U5	Universal input
4	C2		14	24 V DC	Supply
5	U1	Universal input	15	M	Measur. neutral
6	24 V DC	Supply	16	U6	Universal input
7	M	Measur. neutral	17	U7	Universal input
8	U2	Universal input	18	24 V DC	Supply
9	U3	Universal input	19	M	Measur. neutral
10	24 V DC	Supply	20	U8	Universal input

COMMUNICATION

LONWORKS connection

TAC Xenta 300/400 controllers and I/O-modules communicate with each other using a common bus, Echelon LONWORKS® TP/FT-10, Free Topology, 78 kbps. A number of controllers can form a network and exchange data.

The additional I/O units also connect to the network and may be added as required. An I/O unit can only be associated with one controller.

The LONTALK® protocol makes it possible to use Network Variables (NVs; for example I/O values) defined in foreign equipment.

MAINTENANCE

Keep the module dry and clean it externally with a dry cloth when needed.

TAC and TAC products are trademarks and/or registered trademarks of TAC AB.
All other trademarks belong to their respective owners. Copyright 2002 © TAC AB. All rights reserved.